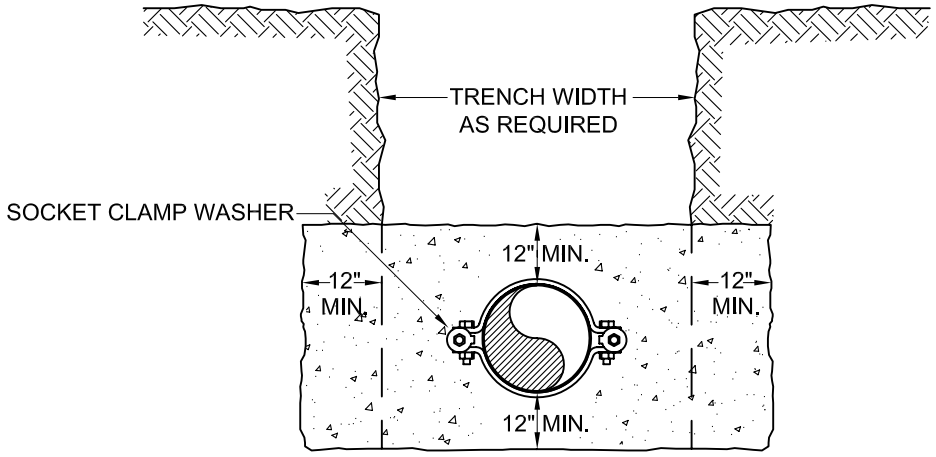

SECTION

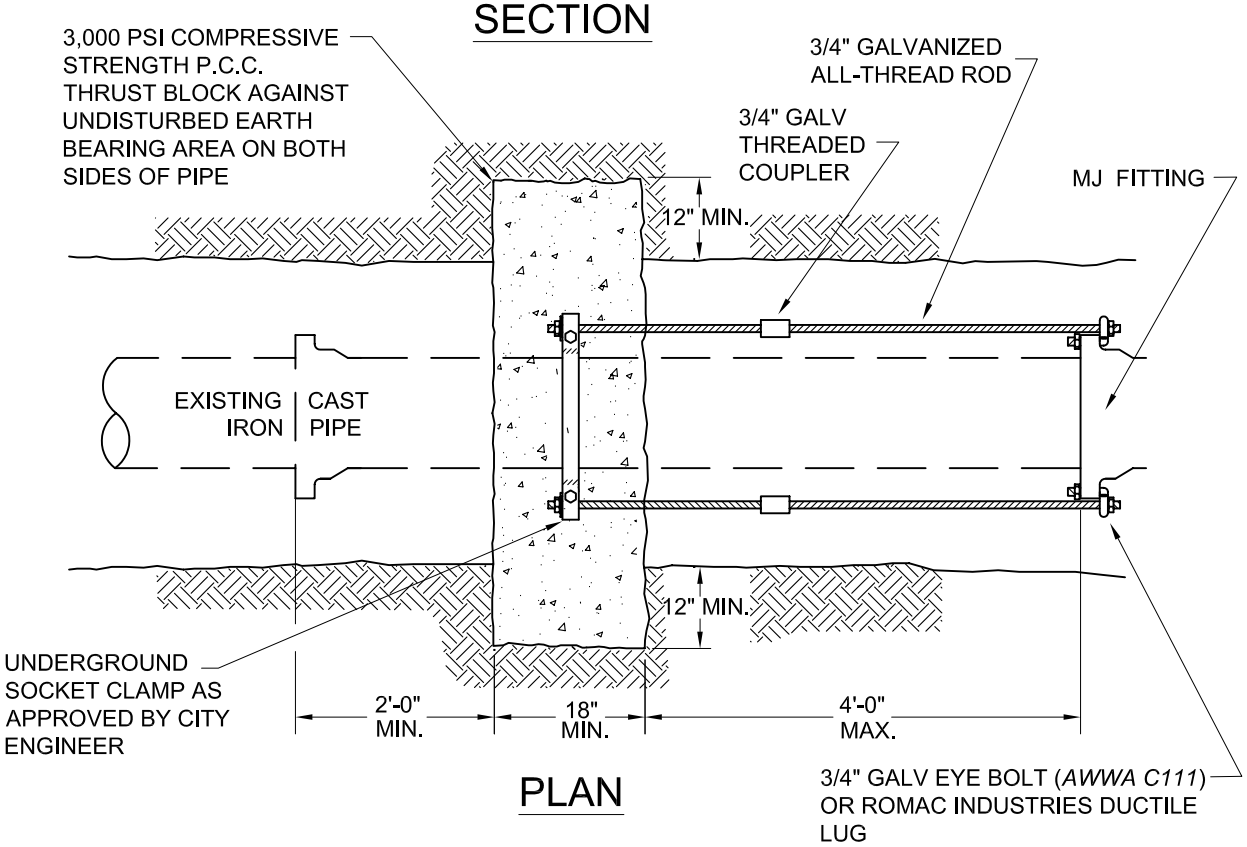

PLAN

MINIMUM BEARING AREA OF IN-LINE THRUST BLOCK	
SIZE (INCHES)	AREA (SQ. FT.)
4	2.2
6	5.0
8	8.7
10	13.6
12	19.6

City Of Beaverton

ENGINEERING DEPARTMENT	STRADDLE THRUST BLOCK EXISTING PIPE CONNECTION		
UTILITIES ENGINEER	DATE	DRAWN BY	DRAWING NO.
David A. Winship, P.E.	6 - 10 - 04	JR - CPD	606